

Aggregate Optimization Chart

Production Gradation Report

PLANT #: **P-2**

Sample Date: 9/23/26

Concrete Grade: **DM-4500HP**

Contractor: _____

Dates Test Represents: 9/24/2026 through 9/30/2026

1" Slump

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
6AA	71-47	Presque Isle	1570	9.79	2.57	52.9
26A	71-47	Presque Isle	200	1.25	2.57	6.7
2NS	63-115	Ray Rd	1200	7.20	2.67	40.4
Total Wt			2970	18.24		100.0

<----- Verify this number is 100%

Sieve	6AA	26A	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	98.0	100.0	100.0	98.9	1.1	1.1
3/4"	82.5	100.0	100.0	90.7	8.2	9.3
1/2"	43.8	97.7	100.0	70.1	20.6	29.9
3/8"	23.2	86.7	100.0	58.5	11.6	41.5
#4	4.0	18.5	95.6	42.0	16.5	58.0
#8	2.1	5.1	79.1	33.4	8.6	66.6
#16	1.9	2.6	62.2	26.3	7.1	73.7
#30	1.8	2.1	45.7	19.6	6.8	80.4
#50	1.7	1.9	24.3	10.8	8.7	89.2
#100	1.6	1.7	6.7	3.7	7.2	96.3
LBW	1.4	1.3	1.1	1.3	2.4	98.7



Superior Materials, LLC

30701 W. 10 Mile Rd.
Suite 500
Farmington Hills, MI 48336

*Maximum % Retained must be above the 3/8" sieve.

*Any two adjacent sieves must equal 10% except max.,

nom. max., #100 and #200 sieves.

*% Retained must be at least 4% for each sieve except max.,

nom. max., #100 and #200 sieves.

*% Retained must be at least 4% for the 3/4" sieve when


a 1.5" max. size (nom. Max. 1.0") aggregate is used.

Production Gradation ☒ Batch Plant Gradations ☐ Aggregate Supplier Gradations

Adjusted WF Initial Production Sample (IPS)

Coarseness Factor:	62	Workability Factor:	33	35.9
--------------------	----	---------------------	----	------

Coarseness Factor:		61	
Workability Factor:		36	
Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	99.3	0.7	0.7
3/4"	89.2	10.1	10.8
1/2"	70.7	18.5	29.3
3/8"	60.7	10.0	39.3
#4	44.4	16.3	55.6
#8	35.9	8.5	64.1
#16	27.3	8.6	72.7
#30	19.1	8.2	80.9
#50	7.4	11.7	92.6
#100	1.9	5.6	98.1
LBW	0.7	1.2	99.3

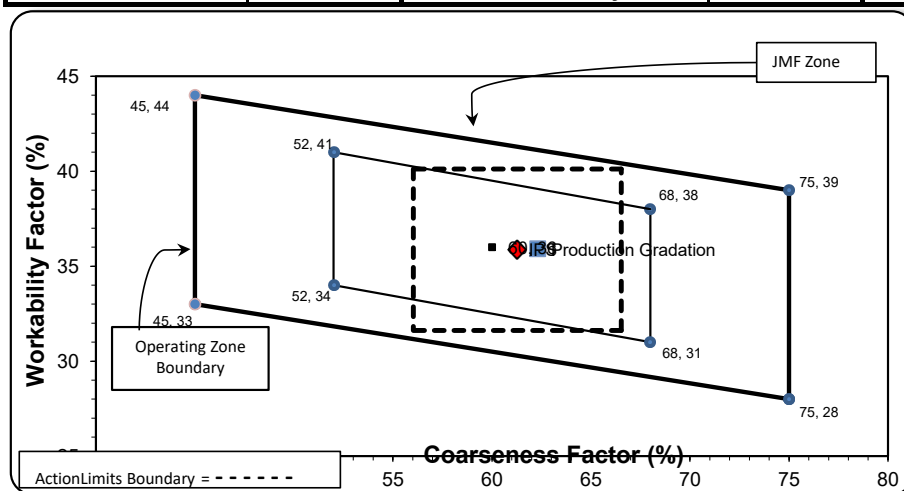

PREPARED BY:
SM, LLC Technical Service

Approved By:
Nancy Donahue

Aggregate Optimization Chart

Production Gradation Report

PLANT #: **P-102**

Sample Date: 9/23/26

Concrete Grade: **DM-4500HP**

Contractor: _____

Dates Test Represents: 9/24/2026 through 9/30/2026

1" Slump

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft³	Specific Gravity	% Contribution
6AA	58-003	StoneCo	1590	9.47	2.69	51.8
1A	58-003	StoneCo	300	1.79	2.69	9.8
2NS	63-114	Highland	1180	7.11	2.66	38.4
Total Wt			3070	18.37		100.0

<----- Verify this number is 100%



Superior Materials, LLC

30701 W. 10 Mile Rd.

Suite 500

Farmington Hills, MI 48336

Sieve	6AA	1A	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	100.0	100.0	100.0	100.0	0.0	0.0
3/4"	84.9	100.0	100.0	92.2	7.8	7.8
1/2"	40.6	87.4	100.0	68.0	24.2	32.0
3/8"	25.1	70.2	100.0	58.3	9.7	41.7
#4	4.4	16.5	98.6	41.8	16.5	58.2
#8	1.6	2.0	80.5	32.0	9.8	68.0
#16	1.5	1.6	84.0	33.2	-1.3	66.8
#30	1.3	1.4	66.0	26.2	7.0	73.8
#50	1.3	1.4	46.5	18.7	7.5	81.3
#100	1.3	1.2	21.7	9.1	9.6	90.9
LBW	1.0	1.1	0.6	0.9	8.3	99.1

*Maximum % Retained must be above the 3/8" sieve.

*Any two adjacent sieves must equal 10% except max.,

nom. max., #100 and #200 sieves.

*% Retained must be at least 4% for each sieve except max.,

nom. max., #100 and #200 sieves.

*% Retained must be at least 4% for the 3/4" sieve when

a 1.5" max. size (nom. Max. 1.0") aggregate is used.


Production Gradation ☐ Batch Plant Gradations ☒ Aggregate Supplier Gradations

Adjusted WF Initial Production Sample (IPS)

Coarseness Factor:	61	Workability Factor:	32	34.5
---------------------------	-----------	----------------------------	-----------	-------------

Coarseness Factor:	61
---------------------------	-----------

Workability Factor:	36
----------------------------	-----------

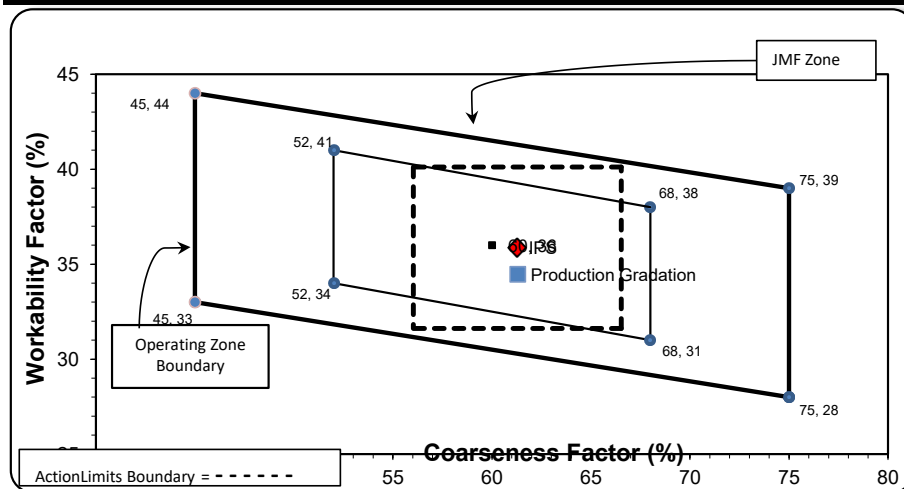

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	99.3	0.7	0.7
3/4"	89.2	10.1	10.8
1/2"	70.7	18.5	29.3
3/8"	60.7	10.0	39.3
#4	44.4	16.3	55.6
#8	35.9	8.5	64.1
#16	27.3	8.6	72.7
#30	19.1	8.2	80.9
#50	7.4	11.7	92.6
#100	1.9	5.6	98.1
LBW	0.7	1.2	99.3

PREPARED BY:
SM, LLC Technical Service

Approved By:
Nancy Donahue

Aggregate Optimization Chart

Production Gradation Report

PLANT #: **P-103**

Sample Date: 9/23/26

Concrete Grade: **DM-4500HP**

Contractor: _____

Dates Test Represents: 9/24/2026 through 9/30/2026

1" Slump

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft³	Specific Gravity	% Contribution
6AA	58-003	StoneCo	1590	9.47	2.69	51.8
1A	58-003	StoneCo	300	1.79	2.69	9.8
2NS	63-114	Highland	1180	7.11	2.66	38.4
Total Wt			3070	18.37		100.0

<----- Verify this number is 100%

Sieve	6AA	1A	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	100.0	100.0	100.0	100.0	0.0	0.0
3/4"	84.9	100.0	100.0	92.2	7.8	7.8
1/2"	40.6	87.4	100.0	68.0	24.2	32.0
3/8"	25.1	70.2	100.0	58.3	9.7	41.7
#4	4.4	16.5	98.6	41.8	16.5	58.2
#8	1.6	2.0	80.5	32.0	9.8	68.0
#16	1.5	1.6	84.0	33.2	-1.3	66.8
#30	1.3	1.4	66.0	26.2	7.0	73.8
#50	1.3	1.4	46.5	18.7	7.5	81.3
#100	1.3	1.2	21.7	9.1	9.6	90.9
LBW	1.0	1.1	0.6	0.9	8.3	99.1



Superior Materials, LLC

30701 W. 10 Mile Rd.
Suite 500
Farmington Hills, MI 48336

*Maximum % Retained must be above the 3/8" sieve.

*Any two adjacent sieves must equal 10% except max.,

nom. max., #100 and #200 sieves.

*% Retained must be at least 4% for each sieve except max.,

nom. max., #100 and #200 sieves.

*% Retained must be at least 4% for the 3/4" sieve when


a 1.5" max. size (nom. Max. 1.0") aggregate is used.

Production Gradation ☐ Batch Plant Gradations ☒ Aggregate Supplier Gradations

Adjusted WF Initial Production Sample (IPS)

Coarseness Factor:	61	Workability Factor:	32	34.5
---------------------------	-----------	----------------------------	-----------	-------------

Coarseness Factor:		61	
Workability Factor:		36	
Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	99.3	0.7	0.7
3/4"	89.2	10.1	10.8
1/2"	70.7	18.5	29.3
3/8"	60.7	10.0	39.3
#4	44.4	16.3	55.6
#8	35.9	8.5	64.1
#16	27.3	8.6	72.7
#30	19.1	8.2	80.9
#50	7.4	11.7	92.6
#100	1.9	5.6	98.1
LBW	0.7	1.2	99.3

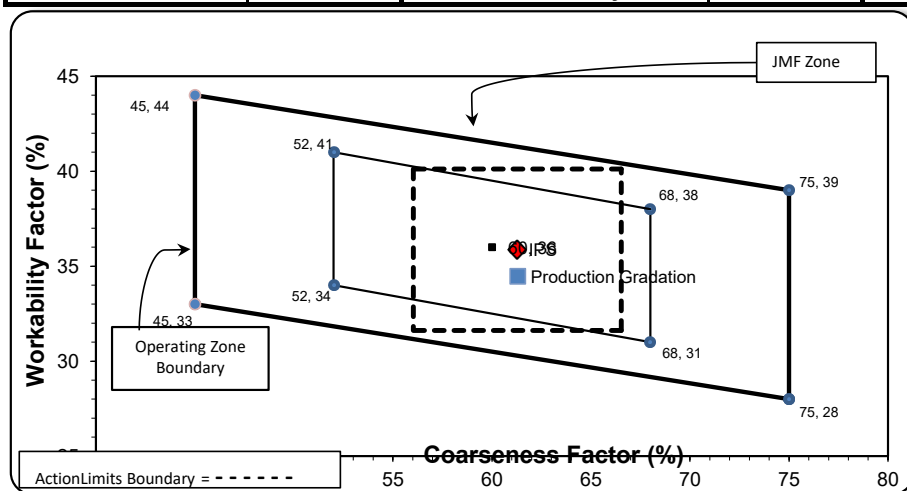

PREPARED BY:
SM, LLC Technical Service

Approved By:
Nancy Donahue